

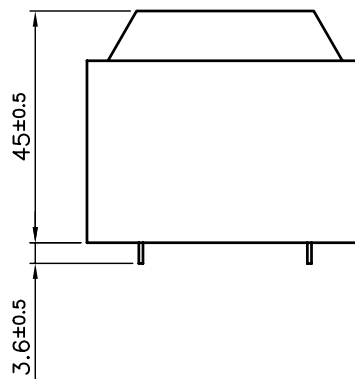
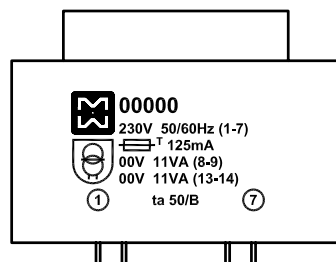


Rev	Date	Modification	Dessiné	Visa
D				
C				
B				
A				

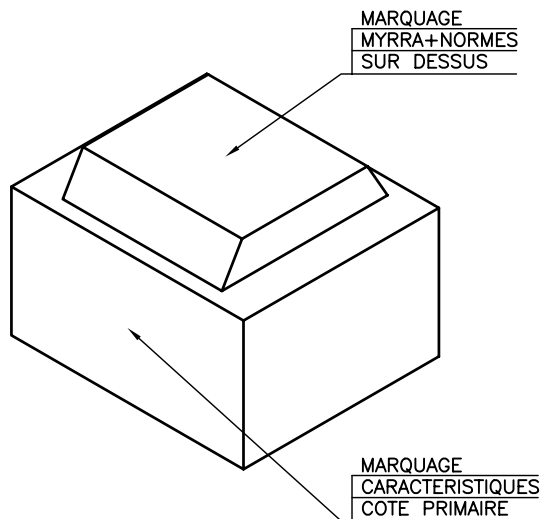

Ref	Primaire	Fusible	Secondaire	ta
44438	230V	125mA	2x6V	50/B
44439	230V	125mA	2x9V	50/B
44440	230V	125mA	2x12V	50/B
44441	230V	125mA	2x15V	50/B
44442	230V	125mA	2x18V	50/B

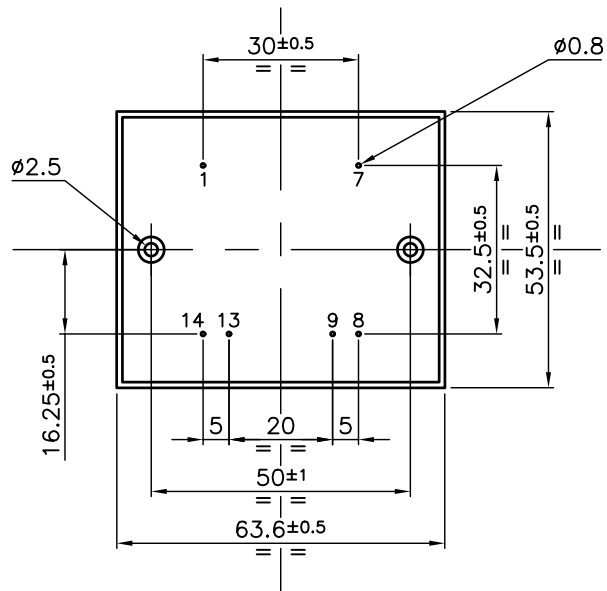

Ref	Primaire	Fusible	Secondaire	ta
44443	230V	125mA	2x24V	50/B

TRANSFORMATEURS 44XXX

- PUISSANCE: 22VA
- PRIMAIRE: 230V (1-7)
- SECONDAIRE: 2x6V A 2x24V (8-9) ET (13-14)
- TEST DIELECTRIQUE: PRI TO SEC 4kV
- MARQUAGE:

CARACTERISTIQUES ELECTRIQUES COTE PRIMAIRE
MYRRA ET NORMES SUR LE DESSUS

<u>Finition:</u>		<u>Tolérance générale:</u>	
<u>Finition:</u>		<u>General tolerance:</u>	
<u>Ech:</u> 1:1	<u>Matière:</u>		
	<u>Material:</u>		
<u>Dessiné par:</u>	ROUSSEL.Ch	<u>Date:</u>	17/10/2003
		<u>Visa:</u>	J.P.M.
<i>TRANSFORMATEURS EI 60</i>			
		22 Allée du Clos des Charmes Z.A. Les Portes de la Forêt 77090 COLLEGIEN Tel : 01-60-37-55-55 Fax : 01-60-17-12-00	EI 60